


# G7TC I/O Blocks

## G7TC-OC16/OC08

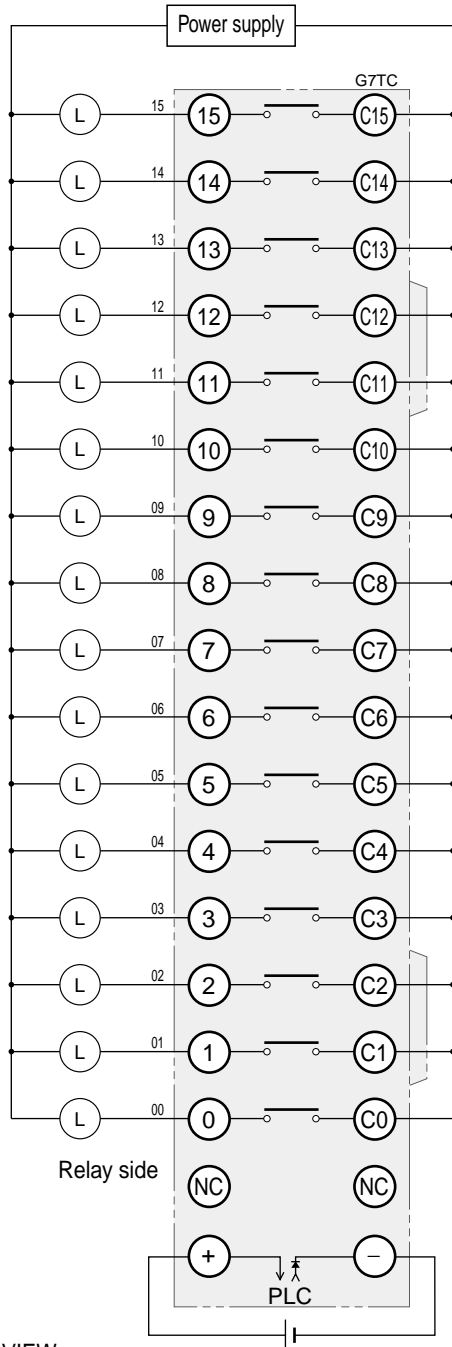


TOP VIEW

Note 1: All contacts are independent. They are isolated from the PLC Output Unit or the Remote Terminal. Numbers 00 to 15 are the output numbers for the corresponding PLC Output Unit or Remote Terminal.

2: The G7TC-OC08 has 8 outputs and so it does not have terminals 8 to 15 and C8 to C15.

3: Use a G78 Shorting Bar to short-circuit across terminals if required.

## G7TC-OC16-1

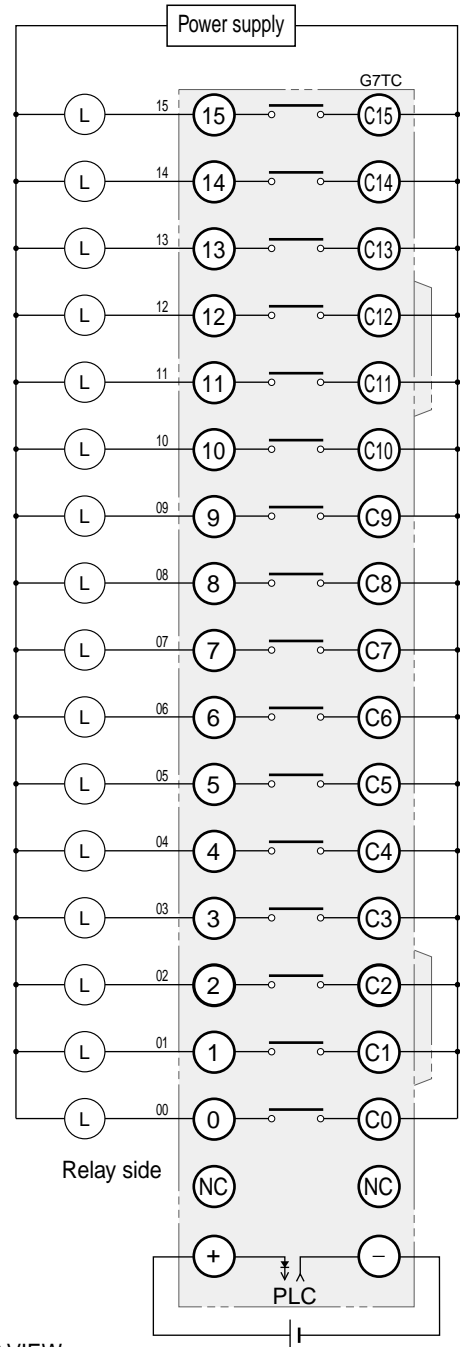

TOP VIEW

Note 1: All contacts are independent. They are isolated from the PLC Output Unit or the Remote Terminal. Numbers 00 to 15 are the output numbers for the corresponding PLC Output Unit or Remote Terminal.

2: Use a G78 Shorting Bar to short-circuit across terminals if required.